



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)  
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY  
PRODUCT CONTROL SECTION

11805 SW 26 Street, Room 208  
Miami, Florida 33175-2474  
T (786) 315-2590 F (786) 315-2599

[www.miamidade.gov/economy](http://www.miamidade.gov/economy)

## NOTICE OF ACCEPTANCE (NOA)

**ICP Construction Inc.**  
**150 Dascomb Road**  
**Andover, MA 01810**

### SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code including the High Velocity Hurricane Zone of the Florida Building Code.

### DESCRIPTION: APOC® Polyset® RTA-1

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA# 21-0202.07 and consists of pages 1 through 8.  
The submitted documentation was reviewed by Alex Tigera.



NOA No.: 22-0614.08  
Expiration Date: 01/03/26  
Approval Date: 10/13/22  
Page 1 of 8

## ROOFING COMPONENT APPROVAL:

**Category:** Roofing  
**Sub Category:** Roof tile adhesive  
**Materials:** Polyurethane

## SCOPE:

This approves **APOC® Polyset® RTA-1** as manufactured by **ICP Construction, Inc.** as described below in this Notice of Acceptance. For the locations where the pressure requirements, as determined by applicable building code, do not exceed the design pressure values obtained by calculations in compliance with RAS 127. For use with approved flat, low, and high profile roof tile systems using Polyset® RTA-1.

## PRODUCTS MANUFACTURED BY APPLICANT:

| <u>Product</u>       | <u>Dimensions</u> | <u>Test Specifications</u> | <u>Product Description</u>                             |
|----------------------|-------------------|----------------------------|--|
| APOC® Polyset® RTA-1 | N/A               | TAS 101                    | Single component polyurethane foam roof tile adhesive. |

## PRODUCTS MANUFACTURED BY OTHERS:

Any Miami-Dade County Product Control Accepted Roof Tile Assembly having a current NOA which list attachment resistance values with the use of Polyset® RTA-1 roof tile adhesive.

## MANUFACTURING LOCATION:

1. Norton, OH.

## PHYSICAL PROPERTIES:

| <u>Property</u>       | <u>Test</u> | <u>Results</u>                        |
|-----------------------|-------------|---------------------------------------|
| Density               | ASTM D 1622 | 1.7 lbs./ft. <sup>3</sup>             |
| Compressive Strength  | ASTM D 1621 | 8.6 psi Parallel to rise              |
| Tensile Strength      | ASTM D 1623 | 25 psi                                |
| Water Absorption      | ASTM D 2842 | 3.2 Lbs./Ft <sup>2</sup>              |
| Water Vapor Permeance | ASTM E 96   | 2.8 perms                             |
| Dimensional Stability | ASTM D 2126 | -0.5% Volume Change @ 70° C., 2 Weeks |
| Closed Cell Content   | ASTM D 2856 | 95.3%                                 |

**Note:** The physical properties listed above are presented as typical average values as determined by accepted ASTM test methods and are subject to normal manufacturing variation.



NOA No.: 22-0614.08  
Expiration Date: 01/03/26  
Approval Date: 10/13/22  
Page 2 of 8

**EVIDENCE SUBMITTED:**

| <u>Test Agency</u>                            | <u>Test Identifier</u> | <u>Test Name/Report</u> | <u>Date</u> |
|---|------------------------|-------------------------|-------------|
| Southwest Research Institute                  | 01-1208-025            | ASTM E 108              | 06/16/98    |
| PRI Construction Materials Technologies, Inc. | FOP-009-02-10          | Physical Properties     | 12/14/10    |
|   | FOP-009-02-01          | TAS-101                 | 11/8/10     |
|   | FOP-009-02-02          | TAS-101                 | 11/4/10     |
|   | FOP-009-02-03          | TAS-101                 | 11/8/10     |
|   | FOP-009-02-04          | TAS-101                 | 11/8/10     |
|   | FOP-009-02-05          | TAS-101                 | 11/8/10     |
| Trinity ERD                                   | ICP-SC10045.11.17-1    | Physical Properties     | 11/21/17    |
| NEMO Etc.                                     | 4-ICP-18-001.05.18-2   | TAS 101 / TAS 123       | 05/15/18    |

**LIMITATIONS:**

1. Fire classification is not part of this acceptance.
2. APOC® Polyset® RTA-1 can be used with flat, low, medium and high tile profiles.
3. Minimum underlayment shall be in compliance with the Roofing Application Standard RAS 120.
4. Roof Tile manufactures acquiring acceptance for the use of APOC® Polyset® RTA-1 roof tile adhesive with their tile assemblies shall test in accordance with TAS 101 with section 10.4 as modified herein.

$$F' = \frac{\left(\frac{F}{2}\right) - W}{MS}$$

5. All products listed herein shall have a quality assurance audit in accordance with the Florida Building Code and Rule 61G20-3 of the Florida Administrative Code.



## INSTALLATION:

1. APOC<sup>®</sup> Polyset<sup>®</sup> RTA-1 may be used with any roof tile assembly having a current NOA that lists attachment resistance values with the use of APOC<sup>®</sup> Polyset<sup>®</sup> RTA-1.
2. APOC<sup>®</sup> Polyset<sup>®</sup> RTA-1 shall be applied in compliance with the Component Application section and the corresponding Placement Details noted herein. The roof tile assembly's adhesive attachment with the use of APOC<sup>®</sup> Polyset<sup>®</sup> RTA-1 shall provide sufficient attachment resistance to meet or exceed the resistance values determined in compliance with Roofing Application Standards RAS 127. The adhesive attachment data is noted in the roof tile assembly NOA.
3. APOC<sup>®</sup> Polyset<sup>®</sup> RTA-1 roof tile adhesive and its components shall be installed in accordance with Roofing Application Standard RAS 120, and ICP Construction, Inc.'s Operating Instruction and Maintenance Booklet
4. Installation must be by a Factory Trained 'Qualified Applicator' approved and licensed by ICP Construction, Inc.
5. Tiles must be adhered in freshly applied adhesive. Tile must be set within 4 minutes after APOC<sup>®</sup> Polyset<sup>®</sup> RTA-1 has been dispensed.
6. APOC<sup>®</sup> Polyset<sup>®</sup> RTA-1 placement shall be in accordance with the 'Placement Details' herein. Each generic tile profile requires the specific placement noted herein.

| <b>Tile Profile</b>         | <b>Typical Placement Detail</b> | <b>Weight per paddy (grams)</b> |
|-----------------------------|---------------------------------|---------------------------------|
| Flat, Low & High Profile    | # 1                             | 11                              |
| High Profile 2-Piece Barrel | # 2                             | 12                              |

## LABELING:

All approved products listed herein shall be labeled and shall bear the imprint or identifiable marking of the manufacturer's name or logo and following statement: "Miami-Dade County Product Control Approved" or the Miami-Dade County Product Control Seal as shown below.



## BUILDING PERMIT REQUIREMENTS:


As required by the Building Official or applicable building code in order to properly evaluate the installation of this system.



NOA No.: 22-0614.08  
Expiration Date: 01/03/26  
Approval Date: 10/13/22  
Page 4 of 8

# ADHESIVE PLACEMENT DETAILS


## PLACEMENT DETAIL # 1

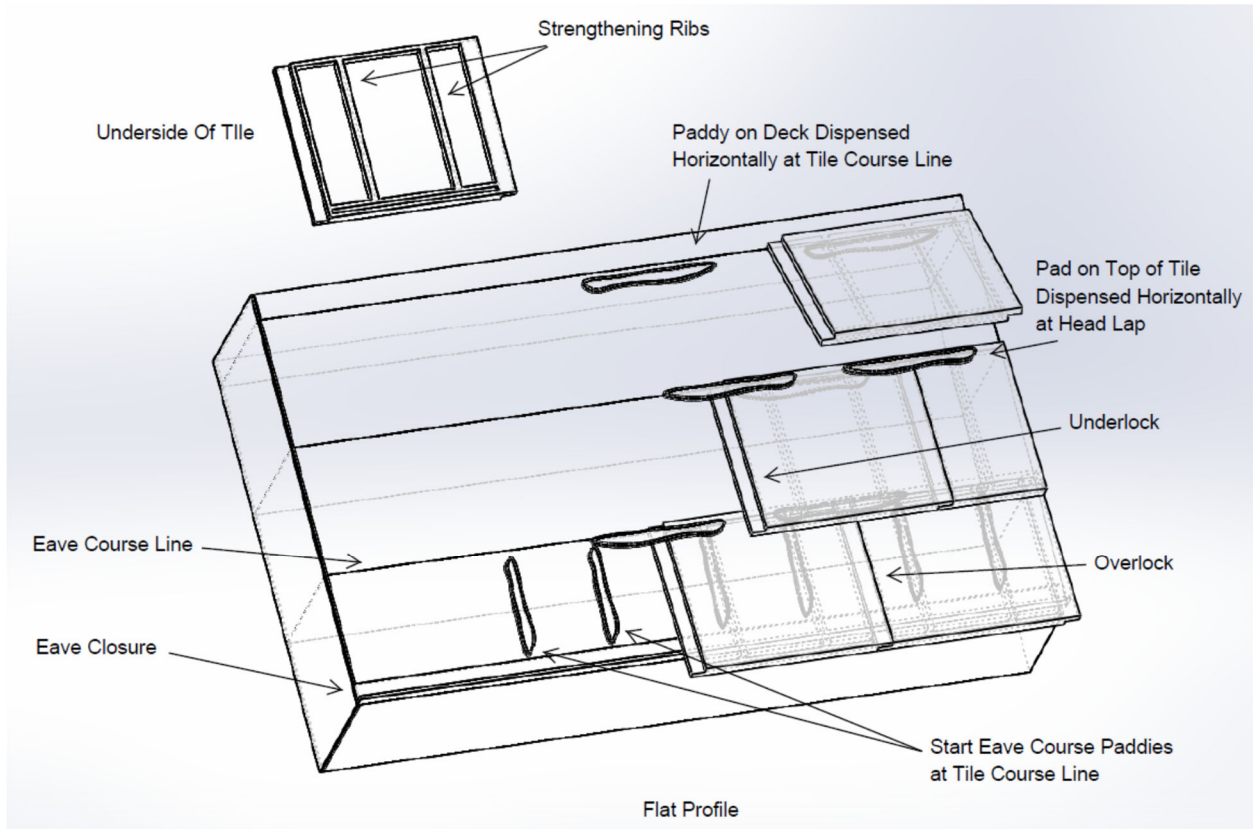

## FLAT PROFILE




**PLACEMENT DETAIL # 1 (CONT...)**

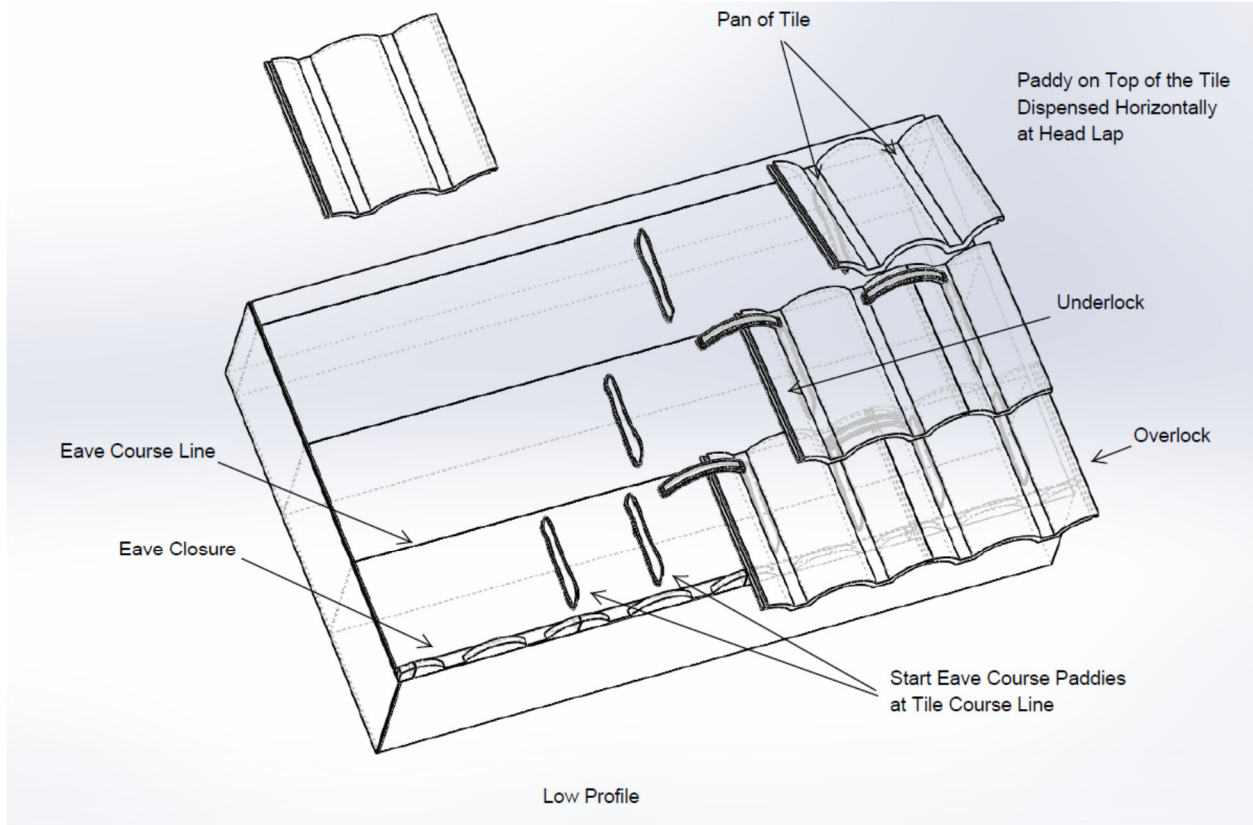


**MEDIUM PROFILE**

## PLACEMENT DETAIL # 2

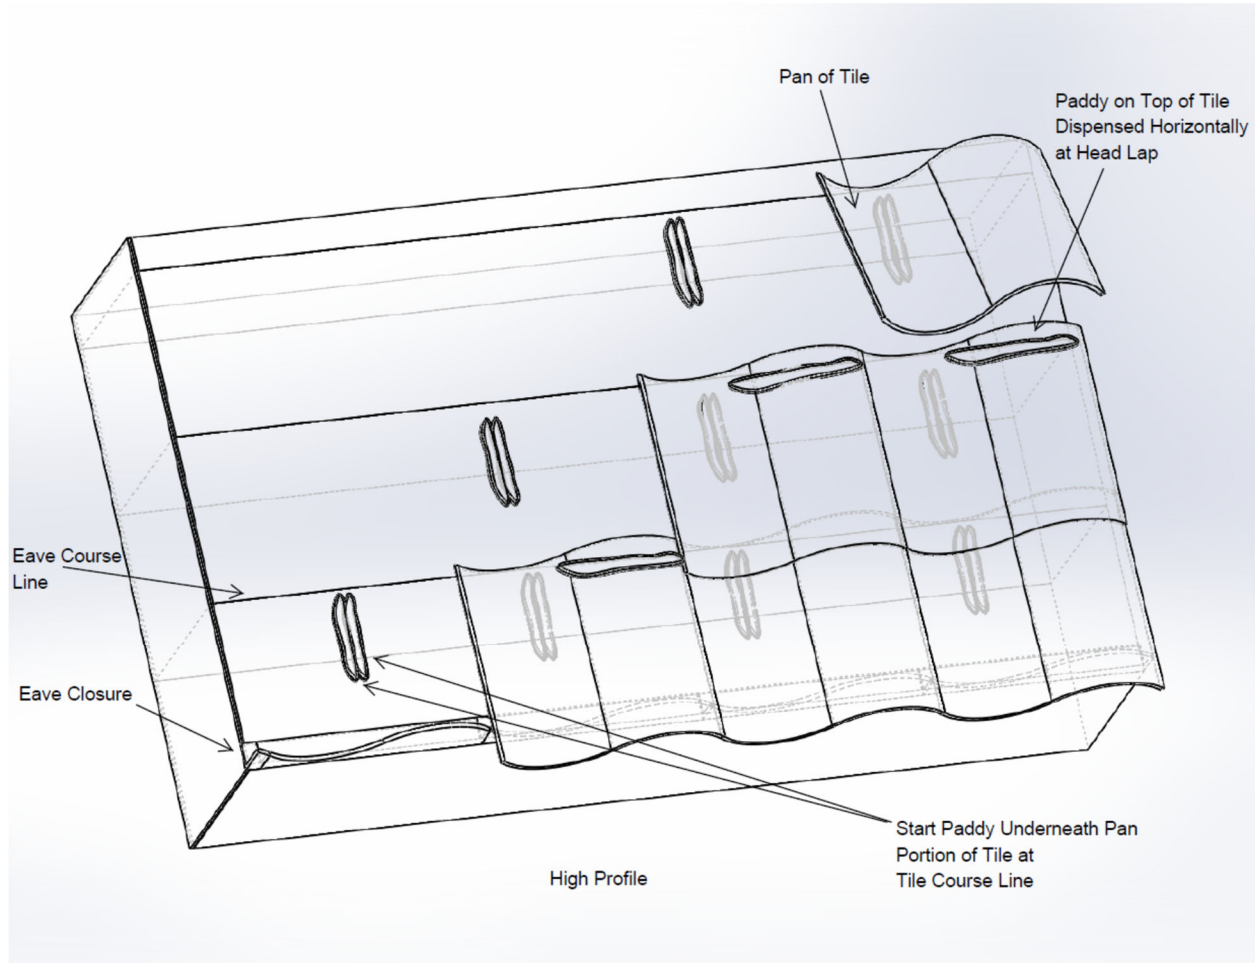

### HIGH PROFILE

## PLACEMENT DETAIL # 2 (CONT...)

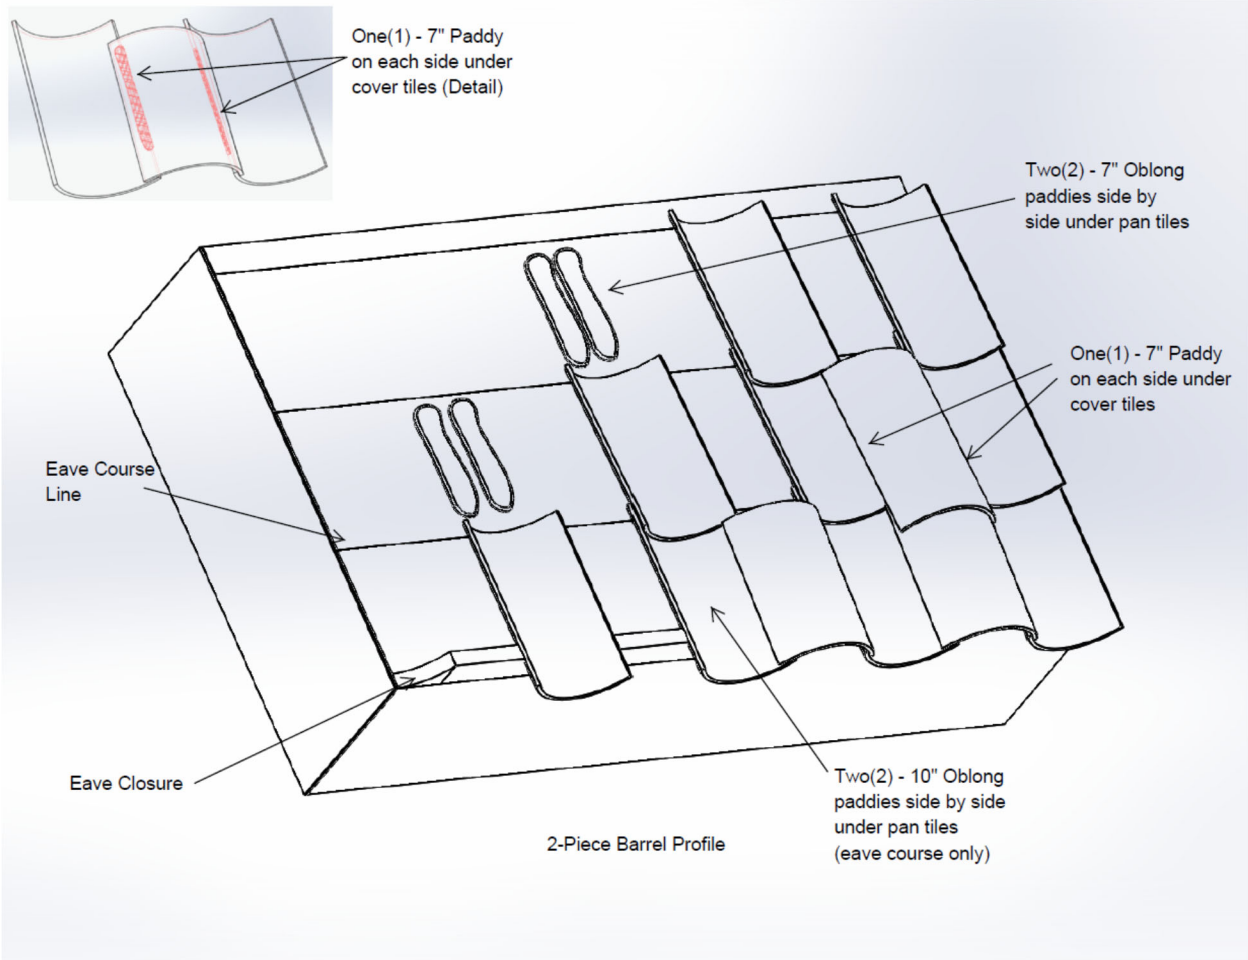

### 2-PIECE BARREL PROFILE

**END OF THIS ACCEPTANCE**



NOA No.: 22-0614.08  
Expiration Date: 01/03/26  
Approval Date: 10/13/22  
Page 8 of 8